



File: 22115

FUNCTIONAL SERVICING REPORT

1570 Niagara Stone Road, Niagara-On-The-Lake

March 2024

INTRODUCTION

The purpose of this report is to address the servicing needs for the proposed residential subdivision development in support of the applications for Zoning By-Law Amendment. The subject land is located at 1570 Niagara Stone Road in the Virgil Community of the Town of Niagara-on-the-Lake; north of Field Road, west of Niagara Stone Road, south of Penner Street, and east of Elden Street. The site has historically been fully developed as the location of the Cornerstone Community Church.

The development site is approximately 0.47 hectare and shall consist of 14 townhouse units, and 24 apartment units in a 4-storey building. The proposed development will include associated asphalt access and parking areas, concrete curb, catch basins, storm sewers, and sanitary sewers.

The objectives of this report are as follows:

1. Identify domestic and fire protection water servicing needs for the site;
2. Identify sanitary servicing needs for the site; and,
3. Identify stormwater management needs for the site.

WATER SERVICING

There is an existing municipal 150mm diameter watermain on Elden Street. It is proposed to connect a 150mm diameter water service to the existing 150mm watermain to provide both domestic water supply and fire protection.

Fire protection will be provided for the proposed development with one private fire hydrant within the site. The location of the proposed hydrant will be identified as part of the detailed engineering design.

To calculate the required fire flow, the Fire Underwriters Survey (FUS 2020) has been conducted for the 4-storey building. The FUS calculations consider different factors such as the type of construction, combustibility of contents, and spatial separation from adjacent buildings. The FUS calculations have determined that a minimum fire flow of 241.54 L/s must be provided without the



inclusion of sprinklers. According to FUS Table 8, the suggested required fire flow for Row Housing with exposure distances less than 3m is 133.33 L/s. Additionally, a fire hydrant flow test was conducted by Niagara Regional Fire Protection on March 1, 2024. The test for the existing hydrant located at 14 Field Road and fronting Elden Street has determined that 413.73 L/s of fire flow will be provided. The FUS fire flow calculations and the fire hydrant flow test results have been enclosed in Appendix A.

Therefore, the existing water supply on Elden Street will adequately provide domestic water supply and fire protection to the 24-unit apartment building and the 14 townhouse units.

SANITARY SERVICING

There is an existing 250mm diameter sanitary sewer along Elden Street which conveys sanitary flows northerly to an existing 350mm diameter sanitary sewer on Penner Street which conveys the flows westerly. It is proposed to connect the new development to the existing 250mm sanitary sewer on Elden Street and extend it within the site.

The existing 250mm diameter sanitary sewer on Elden Street has a full flow capacity of approximately 40.21 L/s, while the 350mm diameter sanitary sewer on Penner Street has a full flow capacity of 83.35 L/s. Currently, the 250mm sewer on Elden Street is flowing at approximately 1.4% of the total capacity, and the 350mm sewer (from MH 68 to MH 67) on Penner Street is flowing at approximately 48.1% of the total capacity.

It is proposed to construct 14 townhouse units and a 24-unit apartment building with an approximate equivalent population of 102 persons. It is estimated that the 250mm diameter sanitary sewer will serve a population of approximately 117 persons and is expected to generate a total peak sanitary flow of approximately 1.74 L/s, occupying 4.3% of the 250mm sanitary sewer's total capacity. Additionally, a sanitary peak flow of approximately 41.08L/s is expected in the downstream 350mm sanitary sewer on Penner Street (from MH 68 to MH 67), which utilizes 49.3% of the 350mm sanitary sewer's full flow capacity.

Therefore, it is expected that this addition will be adequate for the current capacity of the existing sanitary 250mm sanitary sewer on Elden Street and the downstream 350mm sanitary sewer on Penner Street. All the sanitary sewer calculations and supporting plans can be found in Appendix B.

STORMWATER MANAGEMENT

As part of the site development, the following is a summary of the stormwater management plan. The criteria provided by the Town of Niagara-On-The-Lake for this development include the requirement to control stormwater flows from this site up to and including a 100-year design storm event and to provide stormwater quality controls to MECP (70% TSS removal) levels before outletting from the site.

The majority of the stormwater flows on the site are conveyed to Elden Street and Field Road. Flows directed to Elden Street are collected via road catch basins and directed to the existing 375mm diameter storm sewer, which conveys stormwater flows southerly to the existing 1350mm diameter storm sewer on Field Road, flowing west to ultimately discharge into Four Mile Creek. It is proposed to extend the existing 375mm diameter storm sewer approximately 38 meters north on Elden Street, and connect the proposed development to the extended 375mm storm sewer.

Figure 1, Attached in Appendix C, shows the existing Storm Drainage Areas and their associated Runoff Coefficients. Under the existing conditions, around 62% (0.2 ha) of the drainage area A1 land use corresponds to the asphalt parking lot and existing buildings, while the remaining 38% (0.12 ha) of land cover corresponds to grasses. The majority of the land cover for drainage area A3 consists of the asphalt parking lot and buildings. The drainage area impervious has been determined and converted to a Runoff Coefficient for the existing site drainage areas.

The proposed drainage areas and associated Runoff Coefficient from impervious areas are shown in Figure 2, attached in Appendix C. The drainage area being collected by the site stormwater system is 0.49 hectares (A10), the existing area draining to Elden Street is 0.36 hectares (A20), and the area flowing to Field Road is 0.39 hectares (A30).

The existing 375mm diameter storm sewer on Elden Street has a full flow capacity of approximately 258.78L/s, and is flowing at 64.9% of the total capacity, under the existing conditions for a 100 year design storm event. Storm sewer calculations can be found in Appendix C.

The Modified Rational Method (MRM) was used to determine the peak flows and storage volume required for the 100 year storm events as shown in Appendix C. From the MRM analysis, Table 1 shows the comparison for the existing, proposed and allowable stormwater peak flows permitted to discharge Elden Street and Field Road.

Table 1. Peak Flow Summary						
Area #	Area (ha)	Runoff Coefficient		Peak Flows (L/s)		Allowable/Controlled Outflow (L/s)
		Existing	Proposed	Existing	Proposed	
100 Year Design Storm Event						
A1	0.32	0.64		82.1		
A2	0.37	0.58		86.0		
A3	0.45	0.85		153.3		
A10	0.49		0.65		127.6	84.4 (Elden St.)
A20	0.36		0.58		83.7	
A30	0.39		0.85		132.8	153.3 (Field Rd.)

As shown, the existing allowable outflow to Elden Street storm sewer system is the existing flows from A1 and A2, less the proposed flows from A20 or 84.4L/s. The required storm storage to control



to the outflow to 84.4 L/s is 7.5m³. In order to meet the existing allowable conditions for future stormwater flows, and outlet control such as orifice and site stormwater storage, will be implemented at the site. The stormwater will be achieved through the use of underground storage. It is estimated that 66m of 375mm diameter storm sewer will provide storage for the 100 year storm event.

To improve the quality of stormwater, typically an oil/grit separator provide the required Total Suspended Solids (TSS) removal, as required for this type of development. The complete stormwater design for this development shall be identified as part of future detailed design.

CONCLUSIONS AND RECOMMENDATIONS

Therefore, based on the above comments, drainage area plans and calculations provided for this site, the following summarizes the servicing for this site:

1. The existing 150mm diameter watermain on Elden Street is expected to have adequate capacity to provide both domestic water supply and fire protection to service the proposed development.
2. The receiving 250mm diameter sanitary sewers on Elden Street will have adequate capacity to service the Site.
3. Stormwater quantity controls are being provided on site to the allowable capacity of the existing 375mm diameter stormwater sewer on Elden Street.
4. Stormwater quality control will be provided to MECP Normal protection (70% TSS removal) levels prior to discharge from the site.

In conclusion, there exists adequate municipal servicing for this development. We trust the above comments and enclosed calculations are satisfactory for approval. If you have any questions or require additional information, please do not hesitate to contact our office.


Yours very truly,

Prepared By:

Roberto A. Duarte, B. Eng.

Reviewed by:

Jason Schooley, P.Eng.

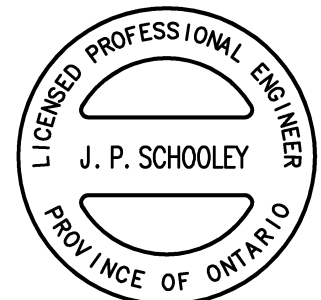

Encl.



**UPPER CANADA
CONSULTANTS**
ENGINEERS / PLANNERS

APPENDICES



**UPPER CANADA
CONSULTANTS**
ENGINEERS / PLANNERS

APPENDIX A

Fire Underwriters Survey (FUS)

Fire Flow Calculation Sheet

Fire Hydrant Testing & Inspection Report

Fire Underwriters Survey

Water Supply for Public Fire Protection (2020) Calculations

1570, Niagara Stone Road, Niagara-On-The-Lake (4 Storey Building)

Required Fire Flow in Litres per Minute

F=	14,493	(L/m)
	241.54	(L/s)
	3,829	(USgmp)

Type of Construction

Non-Combustible Construction (unprotected metal structural components, masonry or metal walls).

C= 0.80

Total Floor Area in square metres

NOTE: All vertical openings are protected. Therefore, use only the largest floor area (667 m²) plus 25% of each of the two adjoining floors.

A= 1043 (m²)

Total Number of Floors

4

2. Combustibility of Contents (may not reduce fire flow demand below 2,000 L/min)

Limited Combustible

= -15%

3. Sprinkler Systems

Is there a complete automatic sprinkler protection system per NFPA (Yes/No).

No 0%

Water supply standard for both system and fire department hose lines (Yes/No).

No 0%

Is system fully monitored (Yes/No).

No 0%

Total Sprinkler Reduction to Overall Fire Flow Demand

0%

4. Spacial Separation of Neighbouring Structures (within 45 metres)

Location of Building:

1570, Niagara Stone Road, Niagara-On-The-Lake (4 Storey Building)

Distance to Nearest Building to the North

18.7 m 15%

Distance to Nearest Building to the South

3.5 m 20%

Distance to Nearest Building to the East

11.7 m 15%

Distance to Nearest Building to the West

32.3 m 5%

Total Spacial Separation to Adjacent Structures

55%

Additions

Is roof wood shingles or shakes (Yes/No).

No


FIRE FLOW CALCULATION SHEET

Project: 1570 Niagara Stone Road
Project Number: 22115
Date: March 4, 2024
Prepared By: Roberto A. Duarte, B.Eng.
Reviewed By: Jason Schooley, P.Eng.

Flow Test Provided by: Niagara Regional Fire Protection
Data of Test: March 1, 2024
Hydrant Location: 14 Field Road

FLOW TEST RESULTS

TEST	PRESSURE (psi)	FLOW RATE (USGPM)	FLOW RATE (L/s)	$Q^{1.852}$	PRESSURE (m)
STATIC	70	0	0	0	49.22
RESIDUAL 1	68	1125.6	71.01	2683.43	47.82
RESIDUAL 2	65	1985.4	125.26	7676.11	45.71

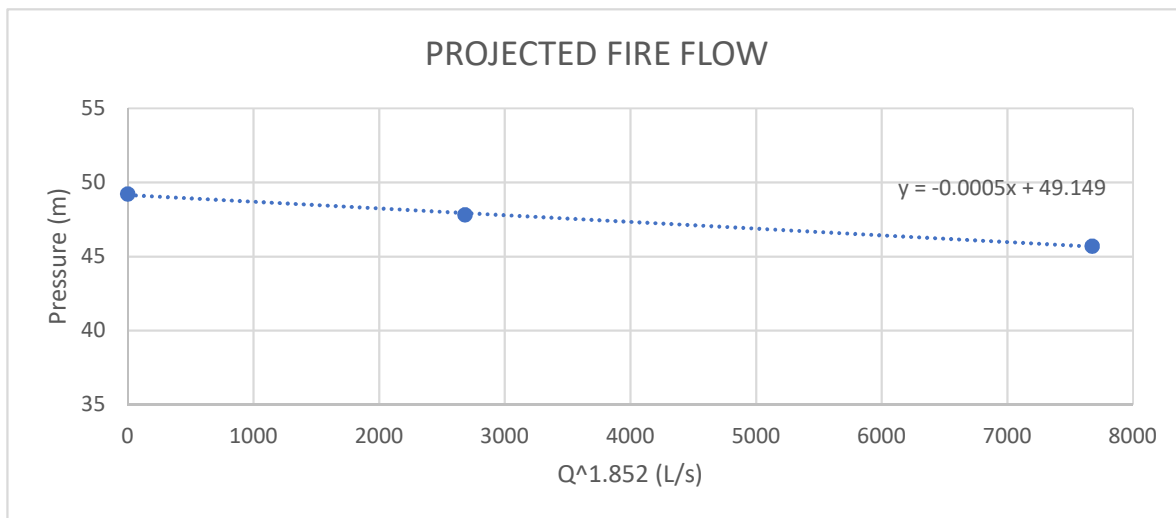

FIRE FLOW FORMULA ($y = ax + b$)

$a = -0.0005$
 $b = 49.149$

FIRE FLOW AT A SPECIFIED PRESSURE

Pressure = 20 psi
 Pressure = 14.064 m
 $Q^{1.852} = 70170.00$
Flow, Q = 413.73 L/s
 Flow, Q = 6557.71 USGPM

PRESSURE AT SPECIFIED FIRE FLOW

Flow (Q) = 0 L/s
 $Q^{1.852} = 0.00$
 Pressure = 49.15 m
 Pressure = 69.89 psi

**Hazen-Williams Equation (1.852)


FIRE FLOW CALCULATION SHEET

Project: 1570 Niagara Stone Road
Project Number: 22115
Date: March 4, 2024
Prepared By: Roberto A. Duarte, B.Eng.
Reviewed By: Jason Schooley, P.Eng.

Flow Test Provided by: Niagara Regional Fire Protection
Data of Test: March 1, 2024
Hydrant Location: 14 Field Road

FLOW TEST RESULTS

TEST	PRESSURE (psi)	FLOW RATE (USGPM)	FLOW RATE (L/s)	Q ^{1.852}	PRESSURE (m)
STATIC	70	0	0	0	49.22
RESIDUAL 1	68	1125.6	71.01	2683.43	47.82
RESIDUAL 2	65	1985.4	125.26	7676.11	45.71

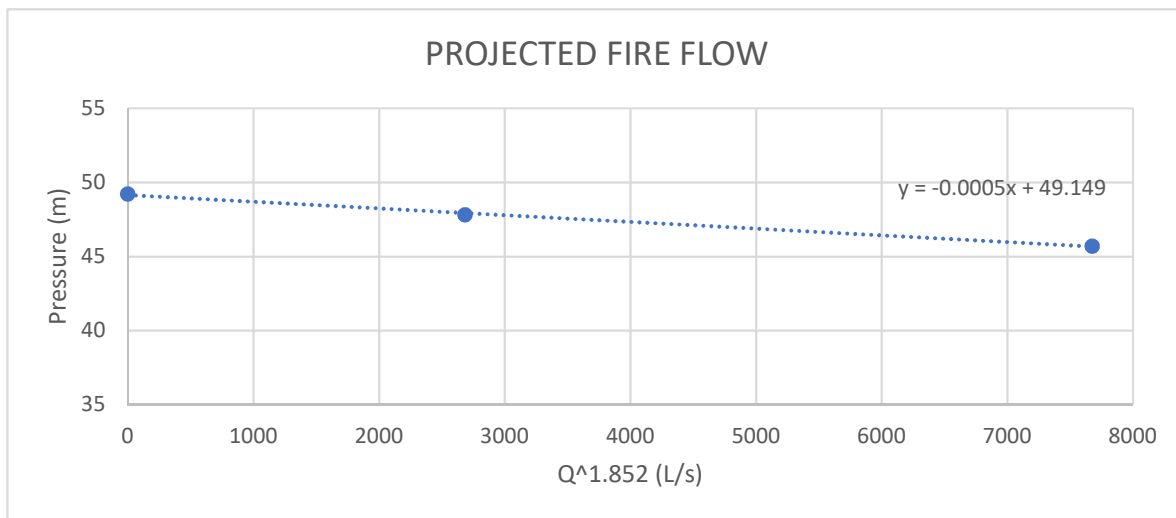

FIRE FLOW FORMULA (y = ax + b)

a = -0.0005
 b = 49.149

FIRE FLOW AT A SPECIFIED PRESSURE

Pressure = 20 psi
 Pressure = 14.064 m
 Q^{1.852} = 70170.00
Flow, Q = 413.73 L/s
 Flow, Q = 6557.71 USGPM

PRESSURE AT SPECIFIED FIRE FLOW

Flow (Q) = 0 L/s
 Q^{1.852} = 0.00
 Pressure = 49.15 m
 Pressure = 69.89 psi


**Hazen-Williams Equation (1.852)

NIAGARA REGIONAL FIRE PROTECTION INC.

Flow Test Location: 14 Field Rd.

Static Pressure (Psi)		Pitot Reading 1	45	# of Outlets Flowed 1	1
	70	Outlet Size 1	2.5	# of Outlets Flowed 2	2
Residual Pressure 1 (Psi)		Pitot Reading 2	35	# of Outlets Flowed 3	2
	68	Outlet Size 2	2.5	Graph Data:	
Residual Pressure 2 (Psi)		Pitot Reading 3	35	Pressure Values (y-axis)	Flow Values (x-axis)
	65	Outlet Size 3	2.5	70	0
Residual Pressure 3 (Psi)		Flow 1 Calculated		68	1126
	65		1125.6	65	1985
		Flow 2 Calculated		65	1985
			1985.4	Date & Time of Test :	
Coefficient value		Flow 3 Calculated		March 1/2024	
	0.9		1985.4	11:00am	
				Performed by:	
				Beau & Cam	

Water Graph

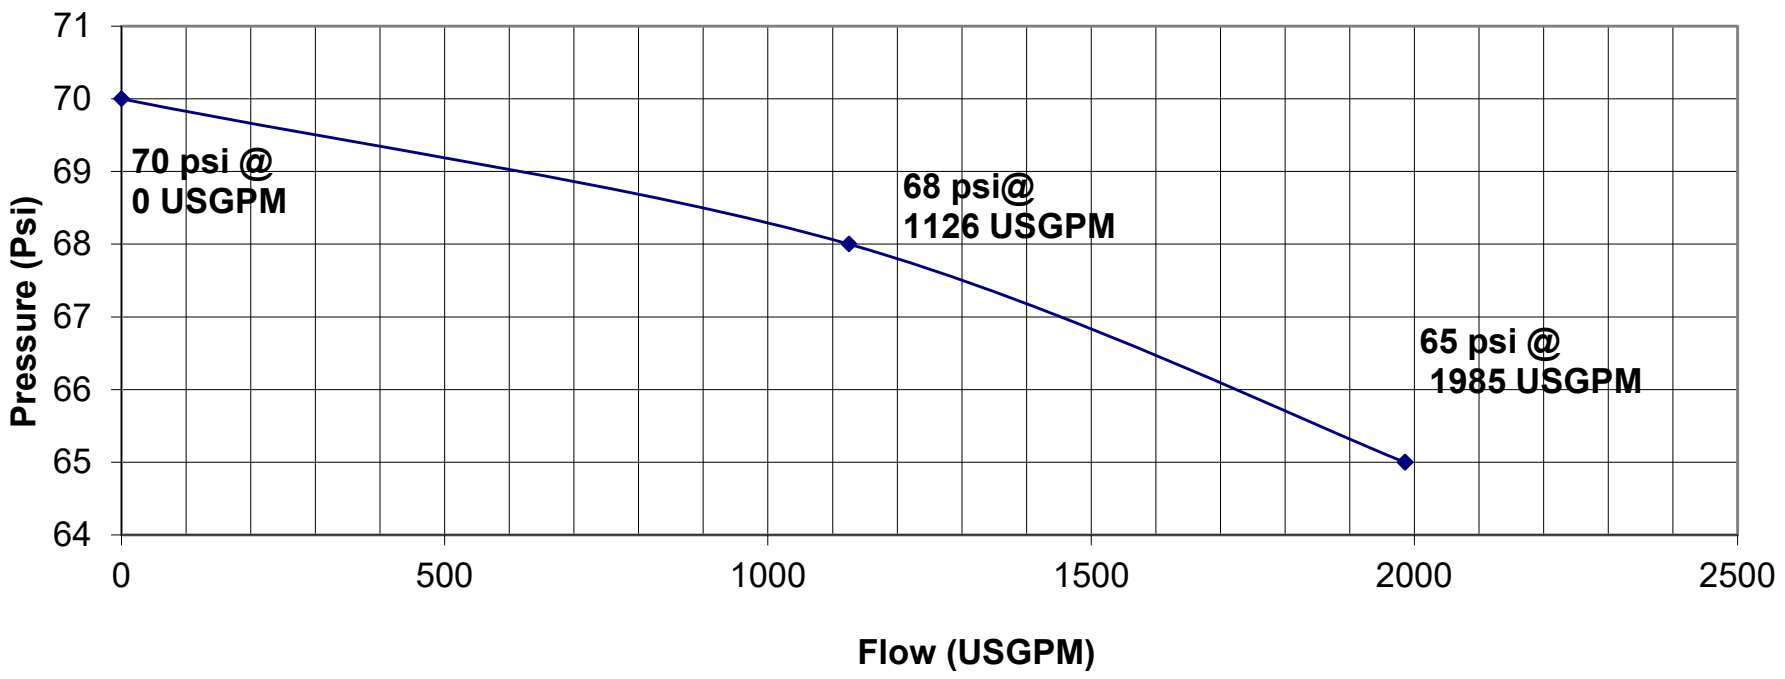


NIAGARA REGIONAL FIRE PROTECTION INC.

Flow Test Location: Corner of Elden and Penner

Static Pressure (Psi)		Pitot Reading 1	50	# of Outlets Flowed 1	1
	70	Outlet Size 1	2.5	# of Outlets Flowed 2	2
Residual Pressure 1 (Psi)		Pitot Reading 2	35	# of Outlets Flowed 3	2
	68	Outlet Size 2	2.5	Graph Data:	
Residual Pressure 2 (Psi)		Pitot Reading 3	35	Pressure Values (y-axis)	Flow Values (x-axis)
	65	Outlet Size 3	2.5	70	0
Residual Pressure 3 (Psi)		Flow 1 Calculated		68	1186
	65		1186.5	65	1985
		Flow 2 Calculated		65	1985
			1985.4	Date & Time of Test :	
Coefficient value		Flow 3 Calculated		March 1/2024	
	0.9		1985.4	11:45am	
				Performed by:	
				Beau & Cam	

Water Graph

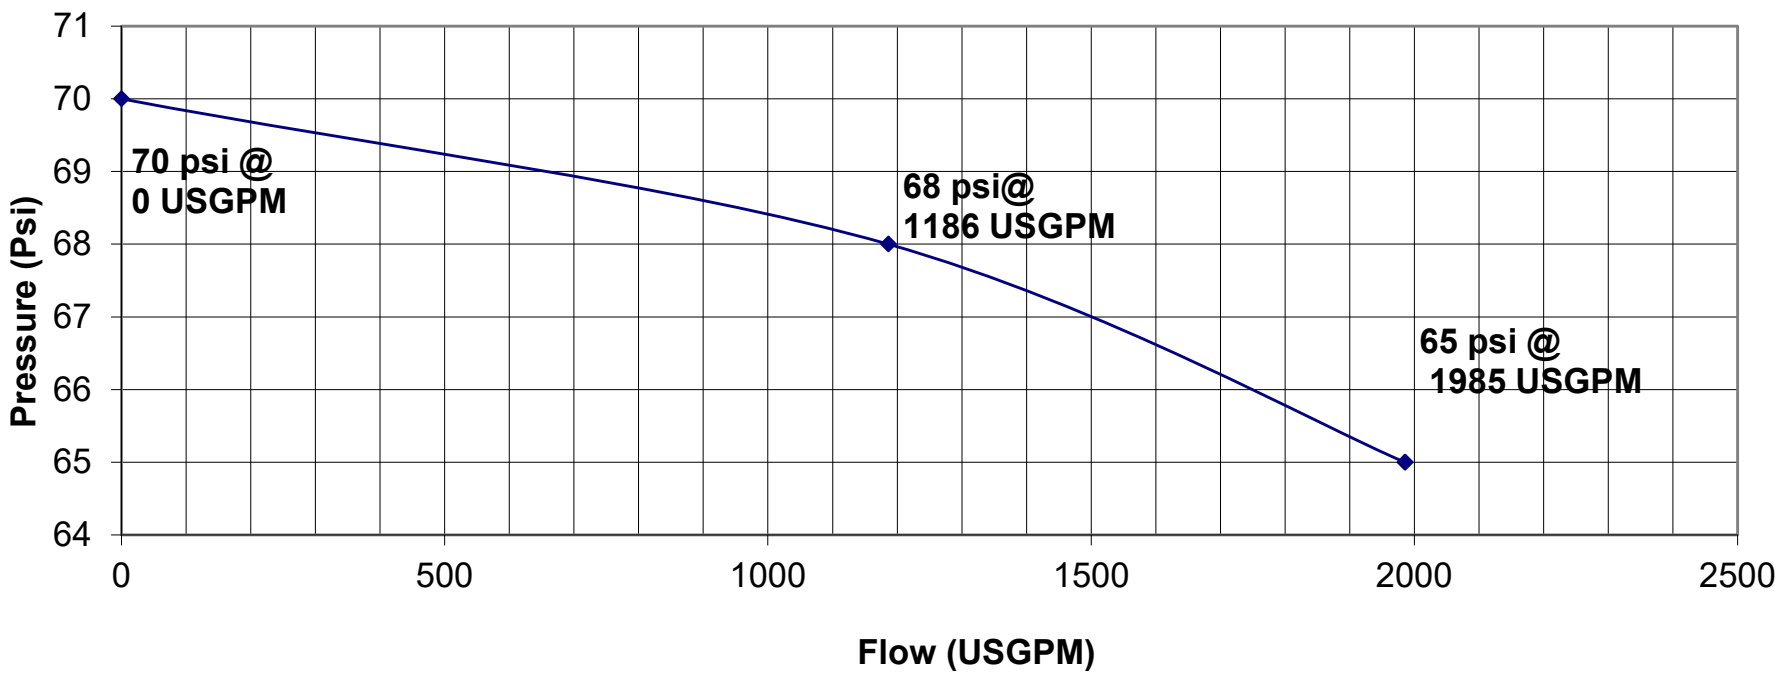



**UPPER CANADA
CONSULTANTS**
ENGINEERS / PLANNERS


APPENDIX B

**Figure 1. Proposed Sanitary Drainage Area Plan.
Sanitary Sewer Design Sheet.**

LEGEND

A0
0.00
00

DRAINAGE AREA NUMBER
DRAINAGE AREA IN HECTARES
POPULATION
DRAINAGE AREA BOUNDARY

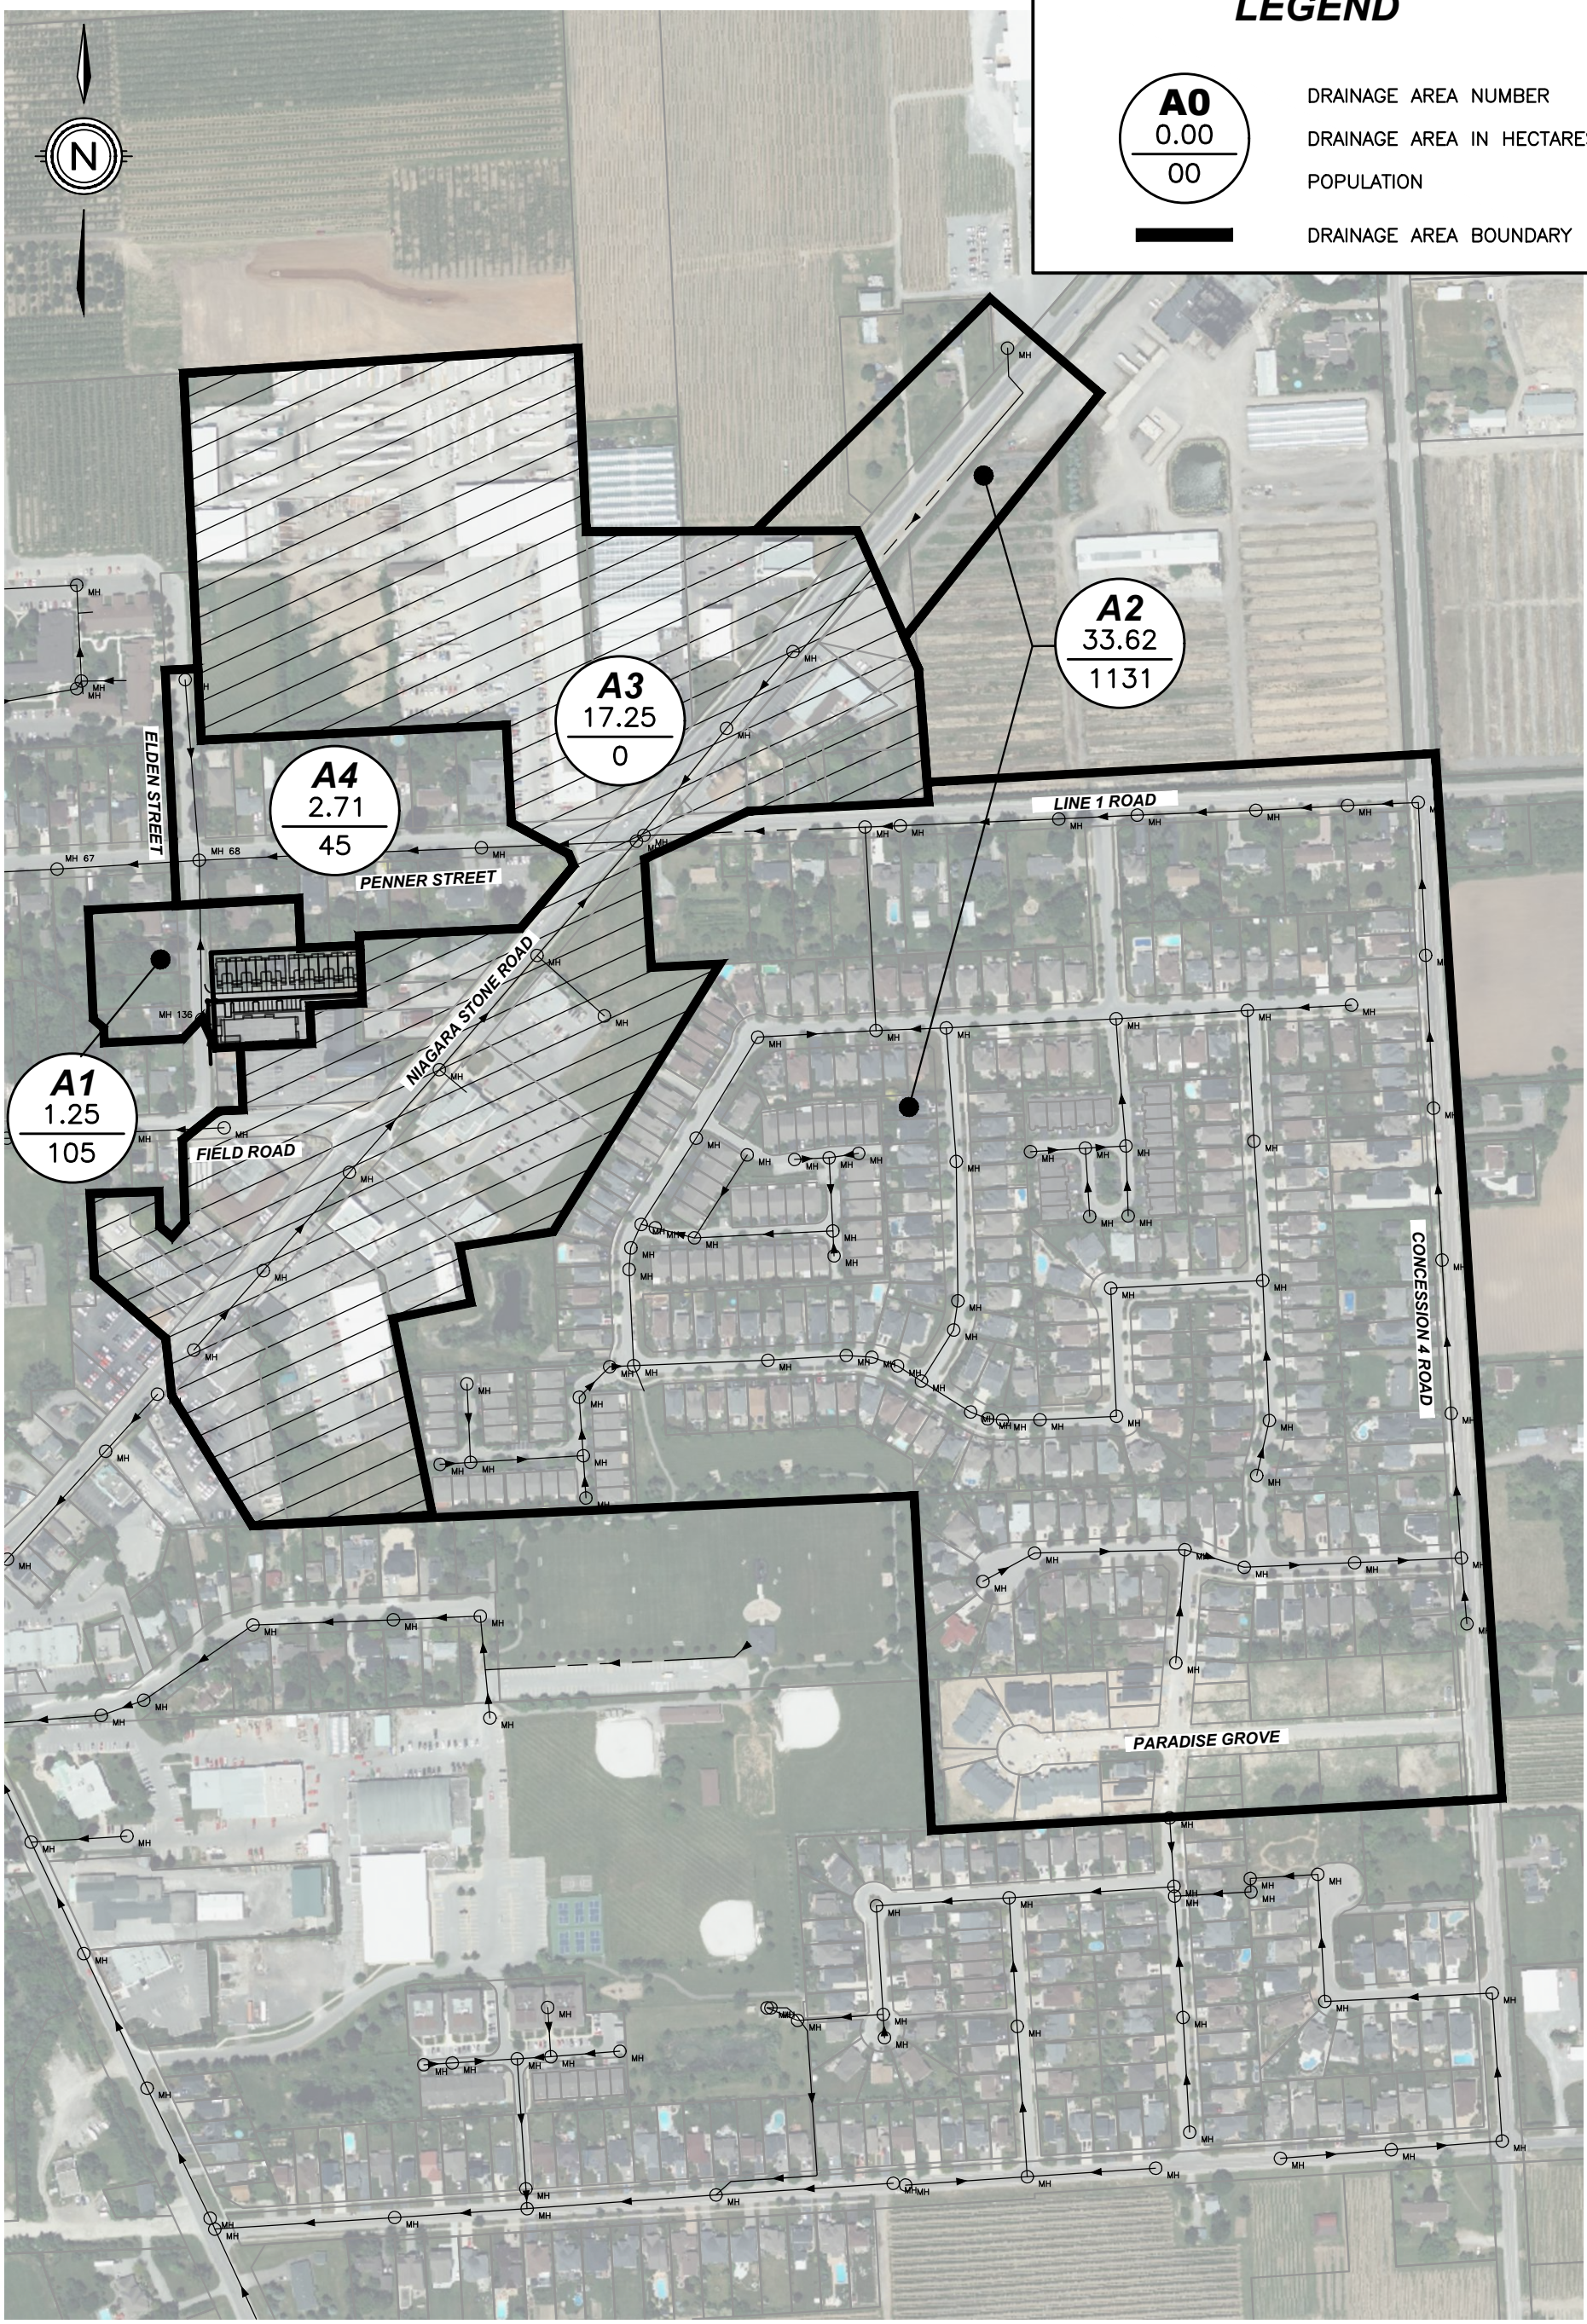

UPPER CANADA CONSULTANTS
ENGINEERS / PLANNERS

1570 NIAGARA STONE ROAD TOWN OF NIAGARA-ON-THE-LAKE

PROPOSED SANITARY DRAINAGE AREA PLAN

DATE	2024-02-06
SCALE	1:4000 m
REF No.	.
DWG No.	SANDA

UPPER CANADA CONSULTANTS
3-30 HANNOVER DRIVE
ST.CATHARINES, ONTARIO
L2W 1A3

DESIGN FLOWS

RESIDENTIAL: 255 LITRES/PERSON/DAY (AVERAGE DAILY FLOW)
 INFILTRATION RATE: 0.286 L / s / ha (M.O.E FLOW ALLOWANCE IS BETWEEN 0.10 & 0.28 L / s / ha)
 POPULATION DENSITY: 3.0 PERSONS / TOWNHOUSE UNIT
 2.5 PERSONS / APARTMENT UNIT
 COMM./INSTITUTIONAL DENSITY: 28.0 m3 / ha / Day (PER MECP)

SEWER DESIGN

PIPE ROUGHNESS: 0.013 FOR MANNING'S EQUATION
 PIPE SIZES: 1.016 IMPERIAL EQUIVALENT FACTOR
 PERCENT FULL: TOTAL PEAK FLOW / CAPACITY

MUNICIPALITY: TOWN OF NIAGARA-ON-THE-LAKE

PROJECT : 1570 Niagara Stone Road

SANITARY SEWER DESIGN SHEET

Peaking Factor= $M = 1 + \frac{14}{4 + P^{0.5}}$ Where P = design population in thousands

PROJECT NO: 22115

LOCATION			AREA		POPULATION				ACCUMULATED PEAK FLOW				DESIGN FLOW					
Location and Description	From M.H	To M.H.	Increment (hectares)	Accumulated (hectares)	Number of Units	Population Density (Person/Unit)	Population Increment	Total Population Served	Peaking Factor	Flow (L/s)	Infiltration Flow L/s	Total Peak Flow (L/s)	Pipe Diameter (mm)	Pipe Length (m)	Pipe Slope (%)	Full Flow Velocity (m/s)	Full Flow Capacity (L/s)	Percent Full
ELDEN STREET																		
A1 - SITE (TOWNHOUSE)			0.47	0.47	14	3	42	42	4.00	0.50	0.13	0.63						
SITE (APARTMENT)				0.47	24	2.5	60	102	4.00	1.20	0.13	1.34						
A1 - EXISTING RESIDENTIAL	MH 136	MH 68	0.78	1.25	5	3	15	117	4.00	1.38	0.36	1.74	250	98.8	0.42	0.79	40.21	4.3%
PENNER STREET																		
A2 - EXISTING RESIDENTIAL			33.62	33.62	377	3	1131	1131	3.76	12.57	9.62	22.18						
A3 - EXISTING COMMERCIAL			17.25	50.87				1131	2.00	11.18	14.55	38.30						
A4 - EXISTING RESIDENTIAL		MH 68	2.71	53.58	15	3	45	1176	3.75	13.03	15.32	39.53						
PENNER STREET	MH 68	MH 67		54.83				1293	3.73	14.22	15.68	41.08	350	91.2	0.30	0.84	83.35	49.3%



**UPPER CANADA
CONSULTANTS**
ENGINEERS / PLANNERS

APPENDIX C

Figure 2. Existing Storm Drainage Area Plan.

Figure 3. Proposed Storm Drainage Area Plan.


Storm Sewer Design Sheet (100 Year Storm Event).

Modified Rational Method – Peak Stormwater Flows for 5 Year Storm Event

Modified Rational Method – Peak Stormwater Flows for 100 Year Storm Event

**1570 NIAGARA STONE ROAD
TOWN OF NIAGARA-ON-THE-LAKE**

EXISTING STORM DRAINAGE AREA PLAN

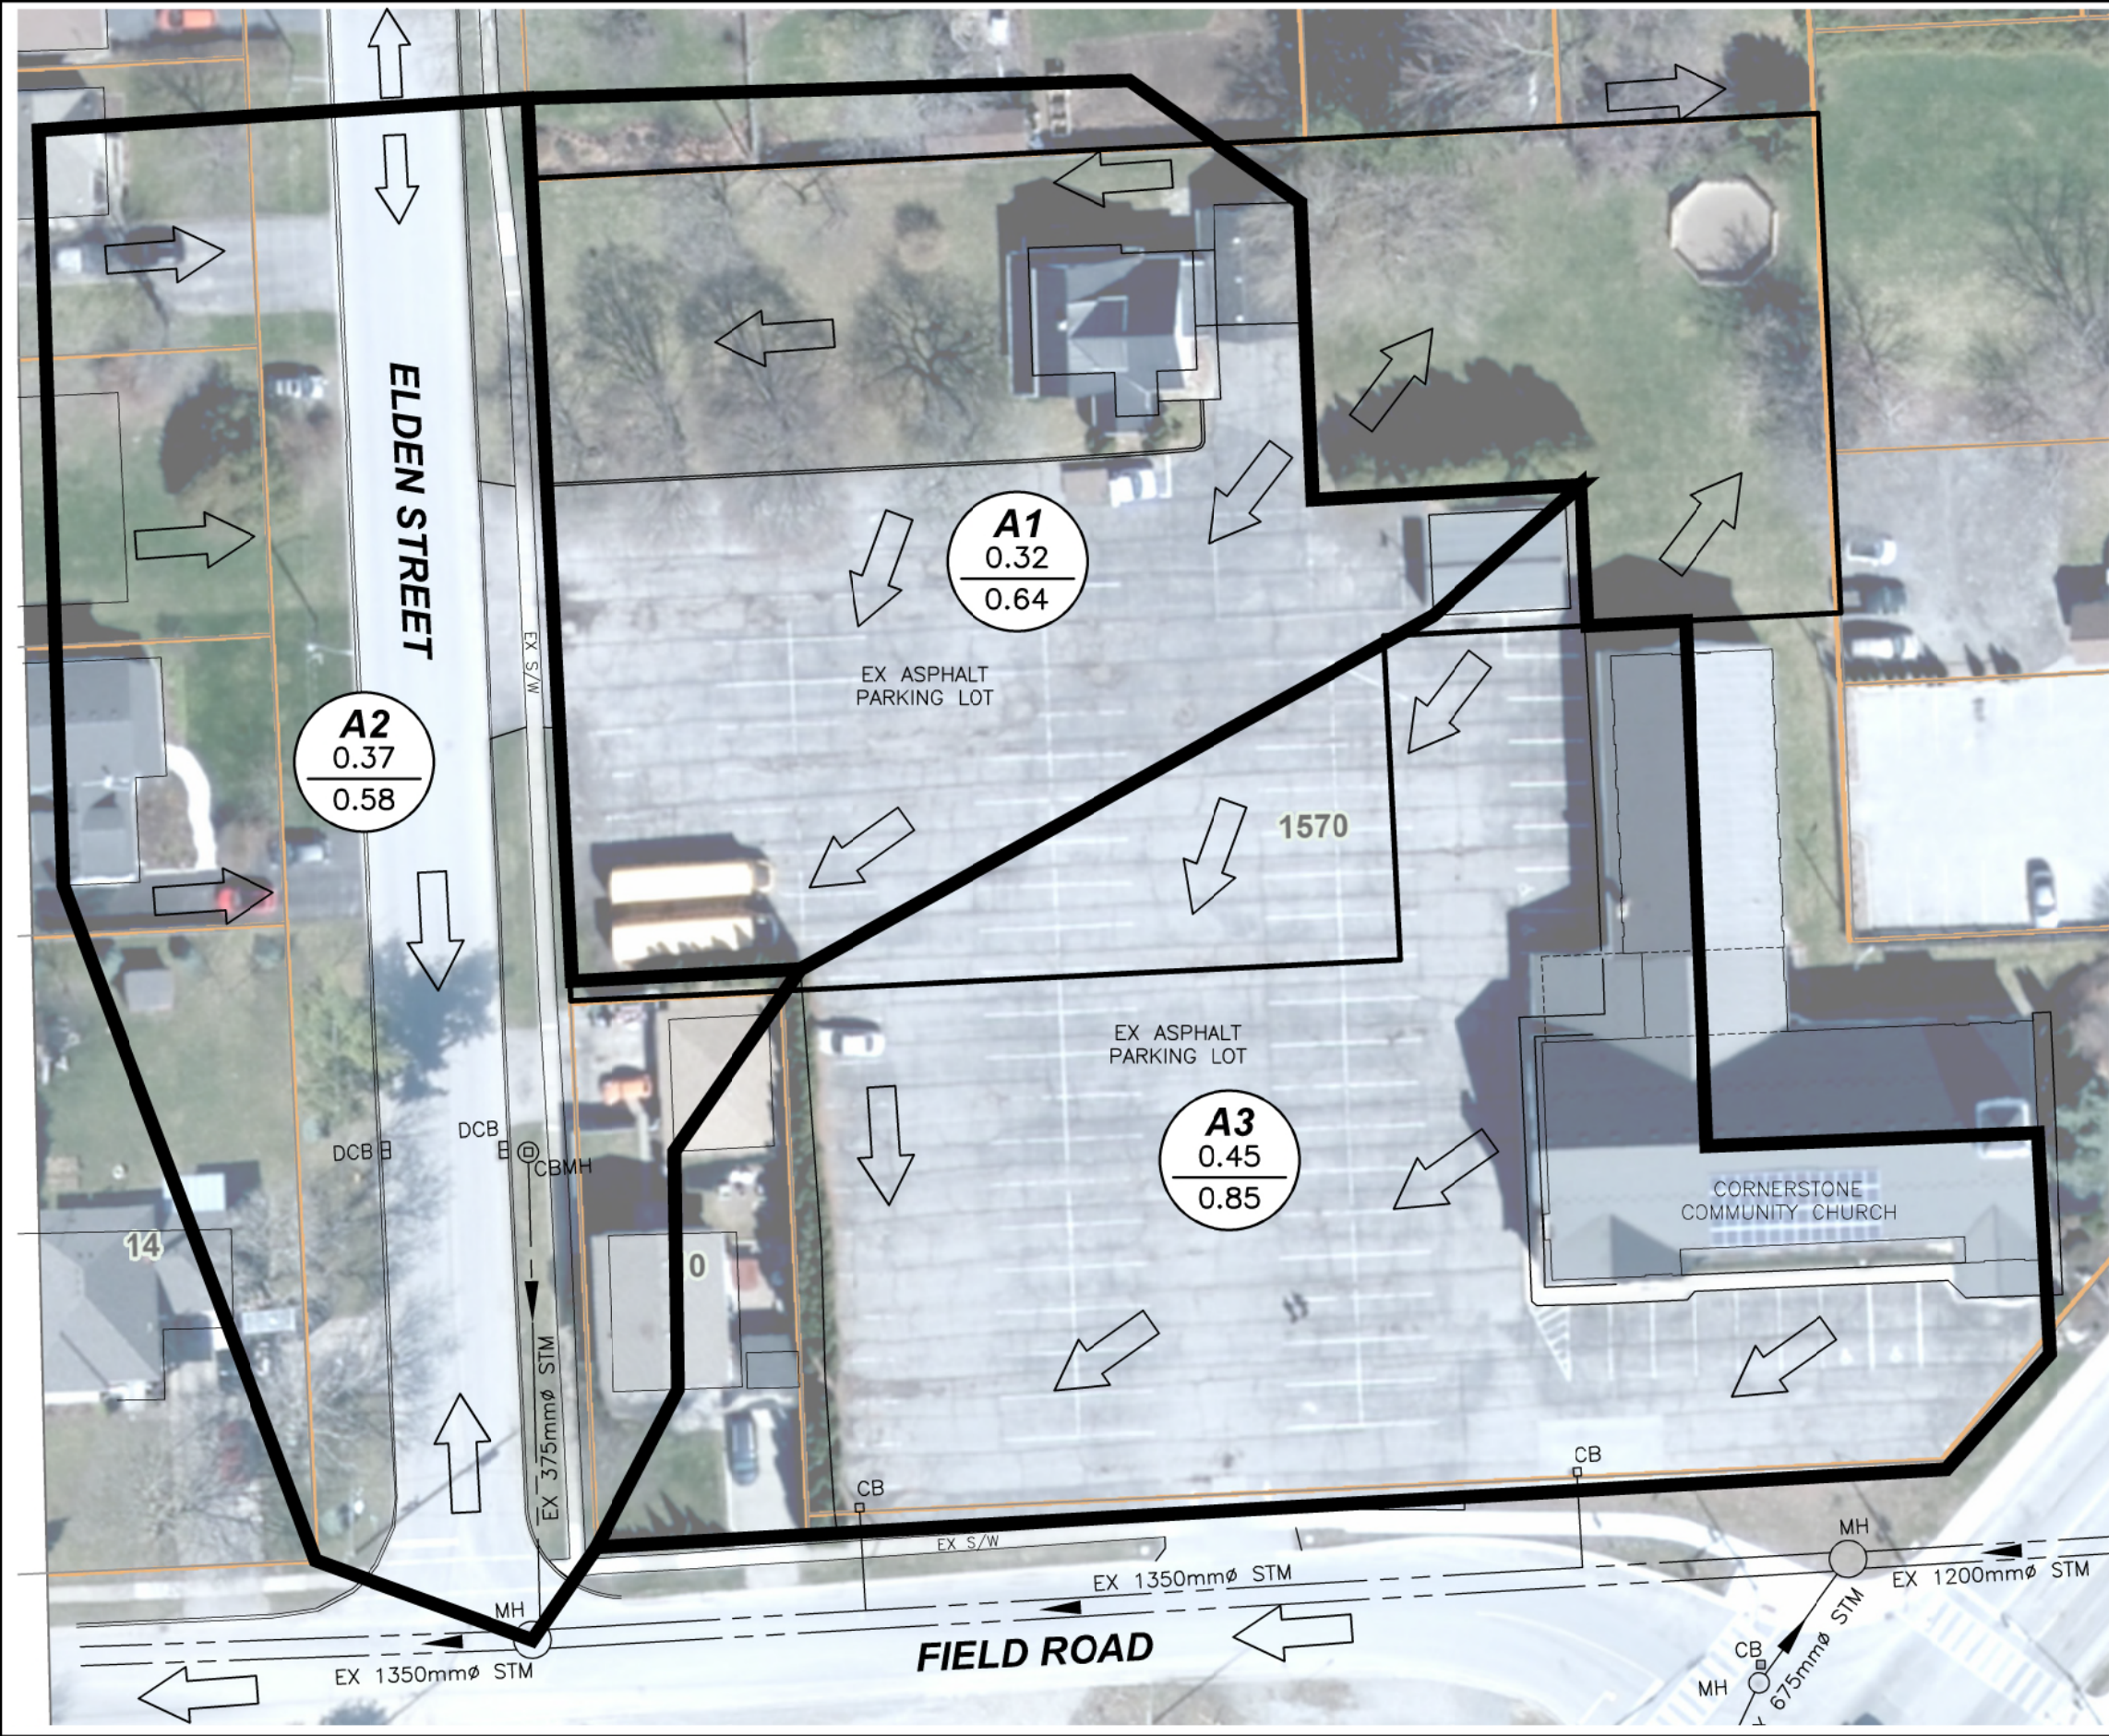

LEGEND

A0	DRAINAGE AREA NUMBER
0.00	DRAINAGE AREA IN HECTARES
0.00	RUN-OFF COEFFICIENT
	DRAINAGE AREA BOUNDARY
	OVERLAND FLOW ROUTE




**UPPER CANADA
CONSULTANTS**
ENGINEERS / PLANNERS

DATE	2024-02-06
SCALE	1:500 m
REF No.	.
DWG No.	FIGURE 1

**1570 NIAGARA STONE ROAD
TOWN OF NIAGARA-ON-THE-LAKE**

PROPOSED STORM DRAINAGE AREA PLAN

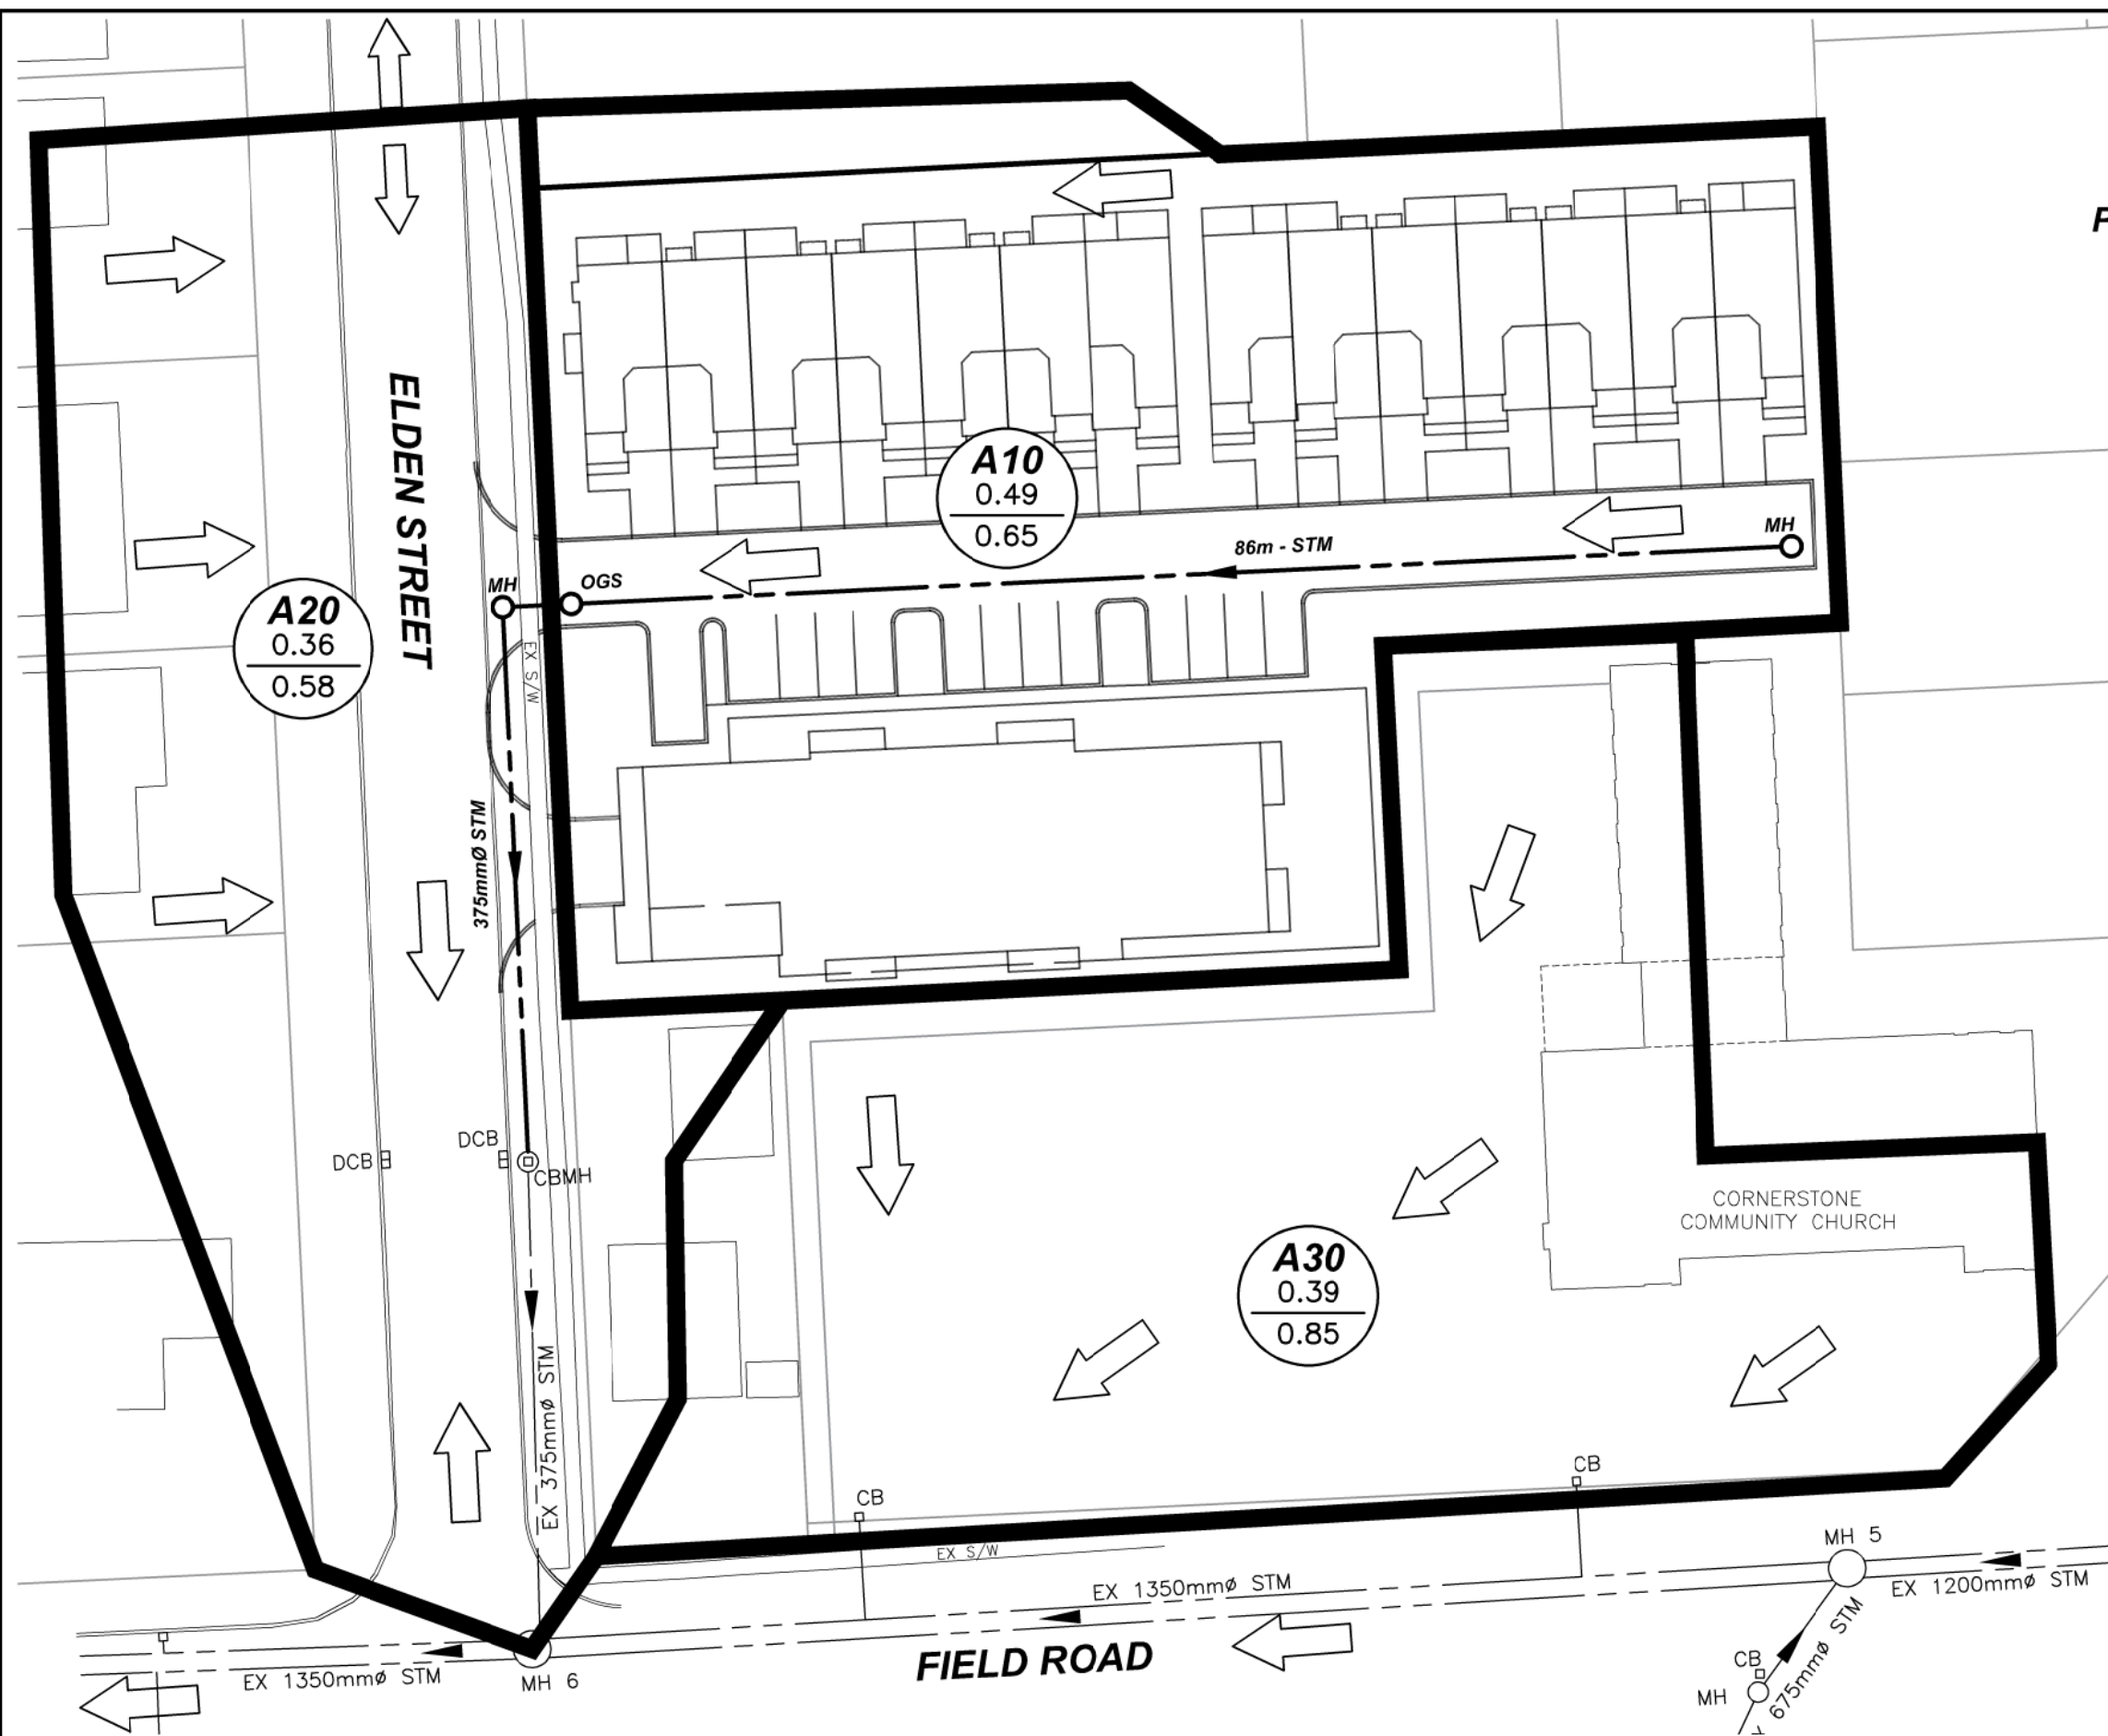

LEGEND

A0	DRAINAGE AREA NUMBER
0.00	DRAINAGE AREA IN HECTARES
0.00	RUN-OFF COEFFICIENT
	DRAINAGE AREA BOUNDARY
	OVERLAND FLOW ROUTE

<p>UPPER CANADA CONSULTANTS ENGINEERS / PLANNERS</p>	DATE	2024-02-06
	SCALE	1:500 m
	REF No.	.
	DWG No.	FIGURE 2

STORM SEWER DESIGN SHEET

PROJECT / SUBDIVISION: 1570 Niagara Stone Road, Town of Niagara On The Lake

LOCATION						TIME OF FLOW		STORMWATER ANALYSIS				
DESCRIPTION	FROM M.H.	TO M.H.	PIPE LENGTH (m)	INCREMENT AREA (hectares)	TOTAL AREA (hectares)	TO UPPER END (min)	IN SECTION (min)	RUNOFF COEFF	SECTION A X R	ACCUMLD A x R	RAINFALL INTENSITY (mm/hr)	PEAK FLOW (L/s)
5 YEAR DESIGN STORM EVENT												
PRE-DEVELOPMENT CONDITIONS												
A1	SITE			0.32	0.32	10.00	0.00	0.640	0.205	0.205	89.884	51.1
A2	ELDEN STREET			0.37	0.37	10.00	0.00	0.580	0.215	0.215	89.884	53.6
A3	FIELD ROAD			0.45	0.45	10.00	0.00	0.850	0.383	0.383	89.884	95.5
POST-DEVELOPMENT CONDITIONS												
A10	SITE			0.49	0.49	10.00	0.00	0.650	0.319	0.319	89.884	79.5
A20	ELDEN STREET			0.36	0.36	10.00	0.00	0.580	0.209	0.209	89.884	52.1
A30	FIELD ROAD			0.39	0.39	10.00	0.00	0.850	0.332	0.332	89.884	82.8
									Allowable Discharge to Elden Street		52.6	
									Allowable Discharge to Field Road		95.5	

DESIGN BY: UPPER CANADA CONSULTANTS
 3-30 HANNOVER DRIVE
 ST. CATHARINES, ON L2W 1A3

DESIGN BY: Roberto Duarte, B. Eng.
DATE: February 9, 2024

RAINFALL PARAMETERS:
 Time to Upper End = 10 min.
 Town of Niagara-on-the-Lake - 5 Year IDF Curve

a = 664.00 mm/hr
 b = 4.70 minutes
 c = 0.74

STORM SEWER DESIGN SHEET

PROJECT / SUBDIVISION: 1570 Niagara Stone Road, Town of Niagara On The Lake

LOCATION						TIME OF FLOW		STORMWATER ANALYSIS				
DESCRIPTION	FROM M.H.	TO M.H.	PIPE LENGTH (m)	INCREMENT AREA (hectares)	TOTAL AREA (hectares)	TO UPPER END (min)	IN SECTION (min)	RUNOFF COEFF	SECTION A X R	ACCUMLD A x R	RAINFALL INTENSITY (mm/hr)	PEAK FLOW (L/s)
100 YEAR DESIGN STORM EVENT												
PRE-DEVELOPMENT CONDITIONS												
A1	SITE			0.32	0.32	10.00	0.00	0.640	0.205	0.205	144.260	82.1
A2	ELDEN STREET			0.37	0.37	10.00	0.00	0.580	0.215	0.215	144.260	86.0
A3	FIELD ROAD			0.45	0.45	10.00	0.00	0.850	0.383	0.383	144.260	153.3
POST-DEVELOPMENT CONDITIONS												
A10	SITE			0.49	0.49	10.00	0.00	0.650	0.319	0.319	144.260	127.6
A20	ELDEN STREET			0.36	0.36	10.00	0.00	0.580	0.209	0.209	144.260	83.7
A30	FIELD ROAD			0.39	0.39	10.00	0.00	0.850	0.332	0.332	144.260	132.8
									Allowable Discharge to Elden Street		84.4	
									Allowable Discharge to Field Road		153.3	

DESIGN BY: UPPER CANADA CONSULTANTS
 3-30 HANNOVER DRIVE
 ST. CATHARINES, ON L2W 1A3

DESIGN BY: Roberto Duarte, B. Eng.
DATE: February 9, 2024

RAINFALL PARAMETERS:
 Time to Upper End = 10 min.
 Town of Niagara-on-the-Lake - 100 Year IDF Curve

a = 980.00 mm/hr
 b = 3.70 minutes
 c = 0.73

Modified Rational Method (MRM) Required Storage Volume

Project: 1570 Niagara Stone Road, NOTL
 Project No: 22115
 Date: 2024-02-09
 Design By: Roberto Duarte, B. Eng.
 Description: Stormwater Management Plan, Quantity Control Storage Volume Calculation

Storm Event: Town of Niagara-on-the-Lake - 100 Year IDF Curve

a = 980.00 mm/hr
 b = 3.70 minutes
 c = 0.73

Critical Storm Duration: 30.00 minutes Tail Multiplier (x1-1.5) 1.5
 Tc From Design: 10.00 minutes
 Storm Tail Time: 15.00 minutes
 Accumulated Area x R (Ha): 0.319 <-- Area x Runoff Coefficient (Sewer Design Sheet)
 Peak Rainfall Intensity: 114.88 mm/hr
 Peak Inflow at Tc: 101.64 L/s
 Maximum Release Rate: 84.39 <-- Outlet Full Flow Capacity (Design Sheet)
 Time When Outlet Exceeded: 8.30

Time (min)	Intensity (mm/hr)	Inflow (L/s)	Outflow (L/s)	Interval Volume (m3)	Total Required Volume (m3)
0.0	0.00	0.00	84.39	-5.1	0.0
1.0	11.49	10.16	84.39	-4.5	0.0
2.0	22.98	20.33	84.39	-3.8	0.0
3.0	34.46	30.49	84.39	-3.2	0.0
4.0	45.95	40.65	84.39	-2.6	0.0
5.0	57.44	50.82	84.39	-2.0	0.0
6.0	68.93	60.98	84.39	-1.4	0.0
7.0	80.41	71.14	84.39	-0.8	0.0
8.0	91.90	81.31	84.39	-0.2	0.0
9.0	103.39	91.47	84.39	0.4	0.4
10.0	114.88	101.64	84.39	1.0	1.5
11.0	114.88	101.64	84.39	1.0	2.5
12.0	114.88	101.64	84.39	1.0	3.5
13.0	114.88	101.64	84.39	1.0	4.6
14.0	114.88	101.64	84.39	1.0	5.6
15.0	114.88	101.64	84.39	1.0	6.6
16.0	107.22	94.86	84.39	0.6	7.3
17.0	99.56	88.08	84.39	0.2	7.5
18.0	91.90	81.31	84.39	-0.2	7.3
19.0	84.24	74.53	84.39	-0.6	6.7
20.0	76.59	67.76	84.39	-1.0	5.7
21.0	68.93	60.98	84.39	-1.4	4.3
22.0	61.27	54.21	84.39	-1.8	2.5
23.0	53.61	47.43	84.39	-2.2	0.3
24.0	45.95	40.65	84.39	-2.6	0.0
25.0	38.29	33.88	84.39	-3.0	0.0
26.0	30.63	27.10	84.39	-3.4	0.0
27.0	22.98	20.33	84.39	-3.8	0.0
28.0	15.32	13.55	84.39	-4.3	0.0
29.0	7.66	6.78	84.39	-4.7	0.0
30.0	0.00	0.00	84.39	-5.1	0.0

Variable Storm Duration Storage Requirements

Duration	Max Storage	Duration	Max Storage	Duration	Max Storage
25 Min	6.5 m3	50 Min	0.0 m3	80 Min	0.0 m3
30 Min	7.5 m3	60 Min	0.0 m3	90 Min	0.0 m3
40 Min	0.7 m3	70 Min	0.0 m3	100 Min	0.0 m3

